



- ALL CONNECTIONS MUST BE METERED WITH A CITY OF CLOVIS METER.
- ALL CONNECTIONS MUST BE PROTECTED BY AN AIR GAP OR R.P. BACKFLOW DEVICE.

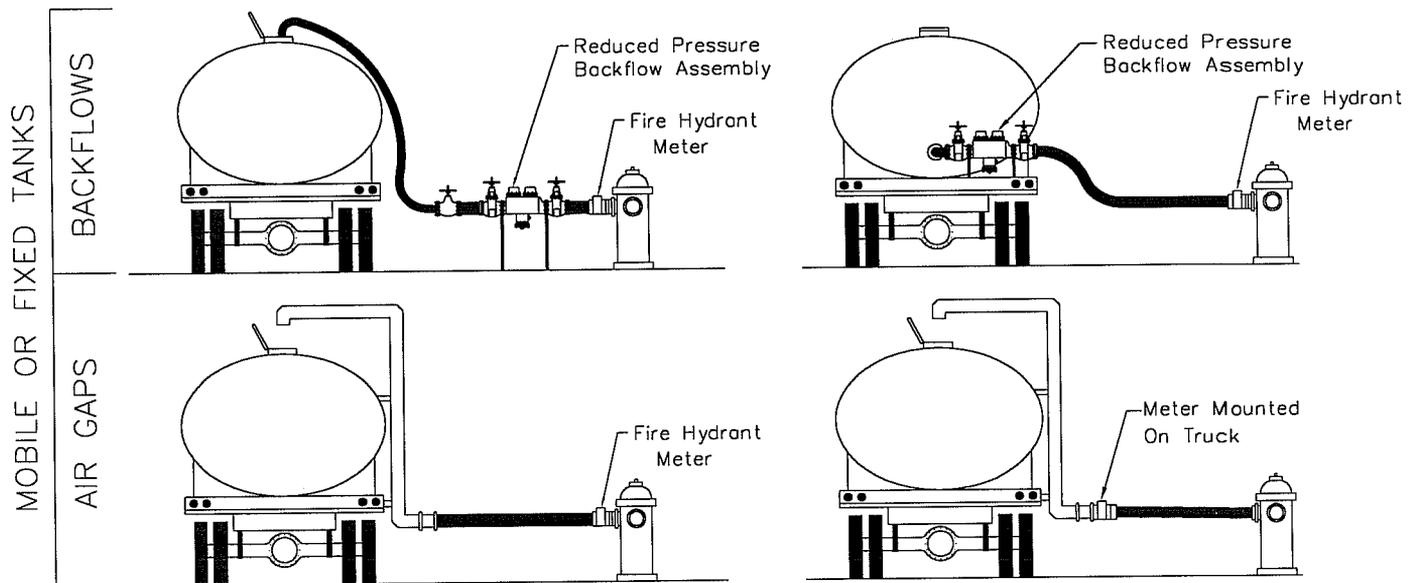

NOTES: PER CITY OF CLOVIS MUNICIPAL CODE.

(A) PERMITS TO USE. NO PERSON SHALL TAKE WATER THROUGH OR FROM ANY FIRE HYDRANT IN THE CITY WITHOUT A VALID PERMIT AND SHALL FIRST FILE WITH THE CITY AN APPLICATION SPECIFYING THE HYDRANT AND THE TIME DESIRED TO TAKE SUCH WATER. PERMITS MAY BE REFUSED ANY PERSON WHO MAY BE INDEBTED TO THE CITY FOR WATER PREVIOUSLY RECEIVED BY SUCH PERSON FROM THE CITY.

(B) ANY PERSON TAKING WATER THROUGH OR FROM ANY CITY FIRE HYDRANT SHALL UTILIZE A HYDRANT METER RENTED FROM THE PUBLIC UTILITIES DEPARTMENT ACCORDING TO THE PERMIT TERMS. AN APPROPRIATE BACKFLOW DEVICE SHALL BE INSTALLED DOWNSTREAM FROM THE HYDRANT METER AS DETERMINED BY THE CITY.

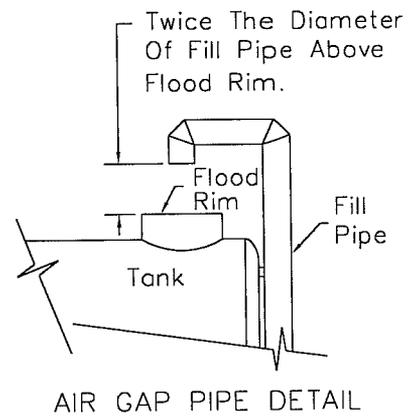

	CITY OF CLOVIS				DWG NO. W-22
	PORTABLE WATER TANK FIRE HYDRANT REGULATIONS				REF. STANDARD SPECIFICATIONS
APPROVED BY:	NO.	REVISED	BY	APPROVALS	SCALE: NTS
CITY ENGINEER		09-29-14	BGJ		DRAWN BY: BGJ
		09-18-14	BGJ		SHEET 1 OF 1
	DATE: 9/20/14		09-24-14		BGJ