
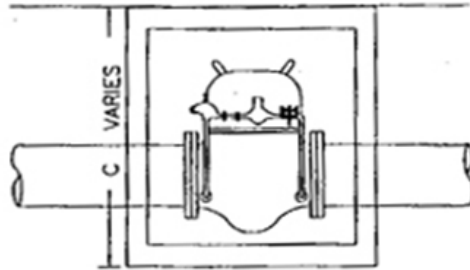


Clovis Fire Department Standard 2.1 Fire Sprinkler Underground

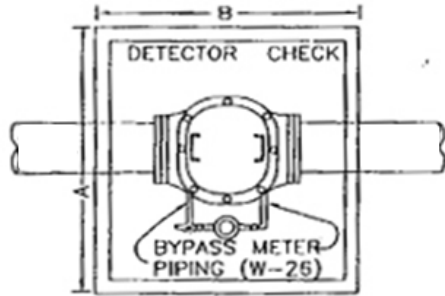

MINIMUM VAULT SIZE			
	A	B	C
4"	36"	36"	24"
6"	42"	48"	30"
8"	48"	48"	30"
10"	48"	60"	42"
DEPTH VARIES			

NOTES

1. DETECTOR CHECK VALVE TO BE AN AMES 1000 OR FEBCO MODEL 800 OR APPROVED EQUAL.
2. CHECK VALVE TO BE TAPPED AND PLUGGED FOR INSTALLATION OF BYPASS METER PIPING.
3. VAULT TO BE CRISTY, BROOKS OR APPROVED EQUAL.
4. VAULT TO PROVIDE MINIMUM OF 12" CLEARANCE AROUND CHECK AND BYPASS METER.
5. VAULT, DETECTOR CHECK VALVE AND VAULT COVER TO BE INSTALLED BY DEVELOPER / CONTRACTOR AS PER STD 2.1.

