Figure ES-2
Fire Hazards Zones

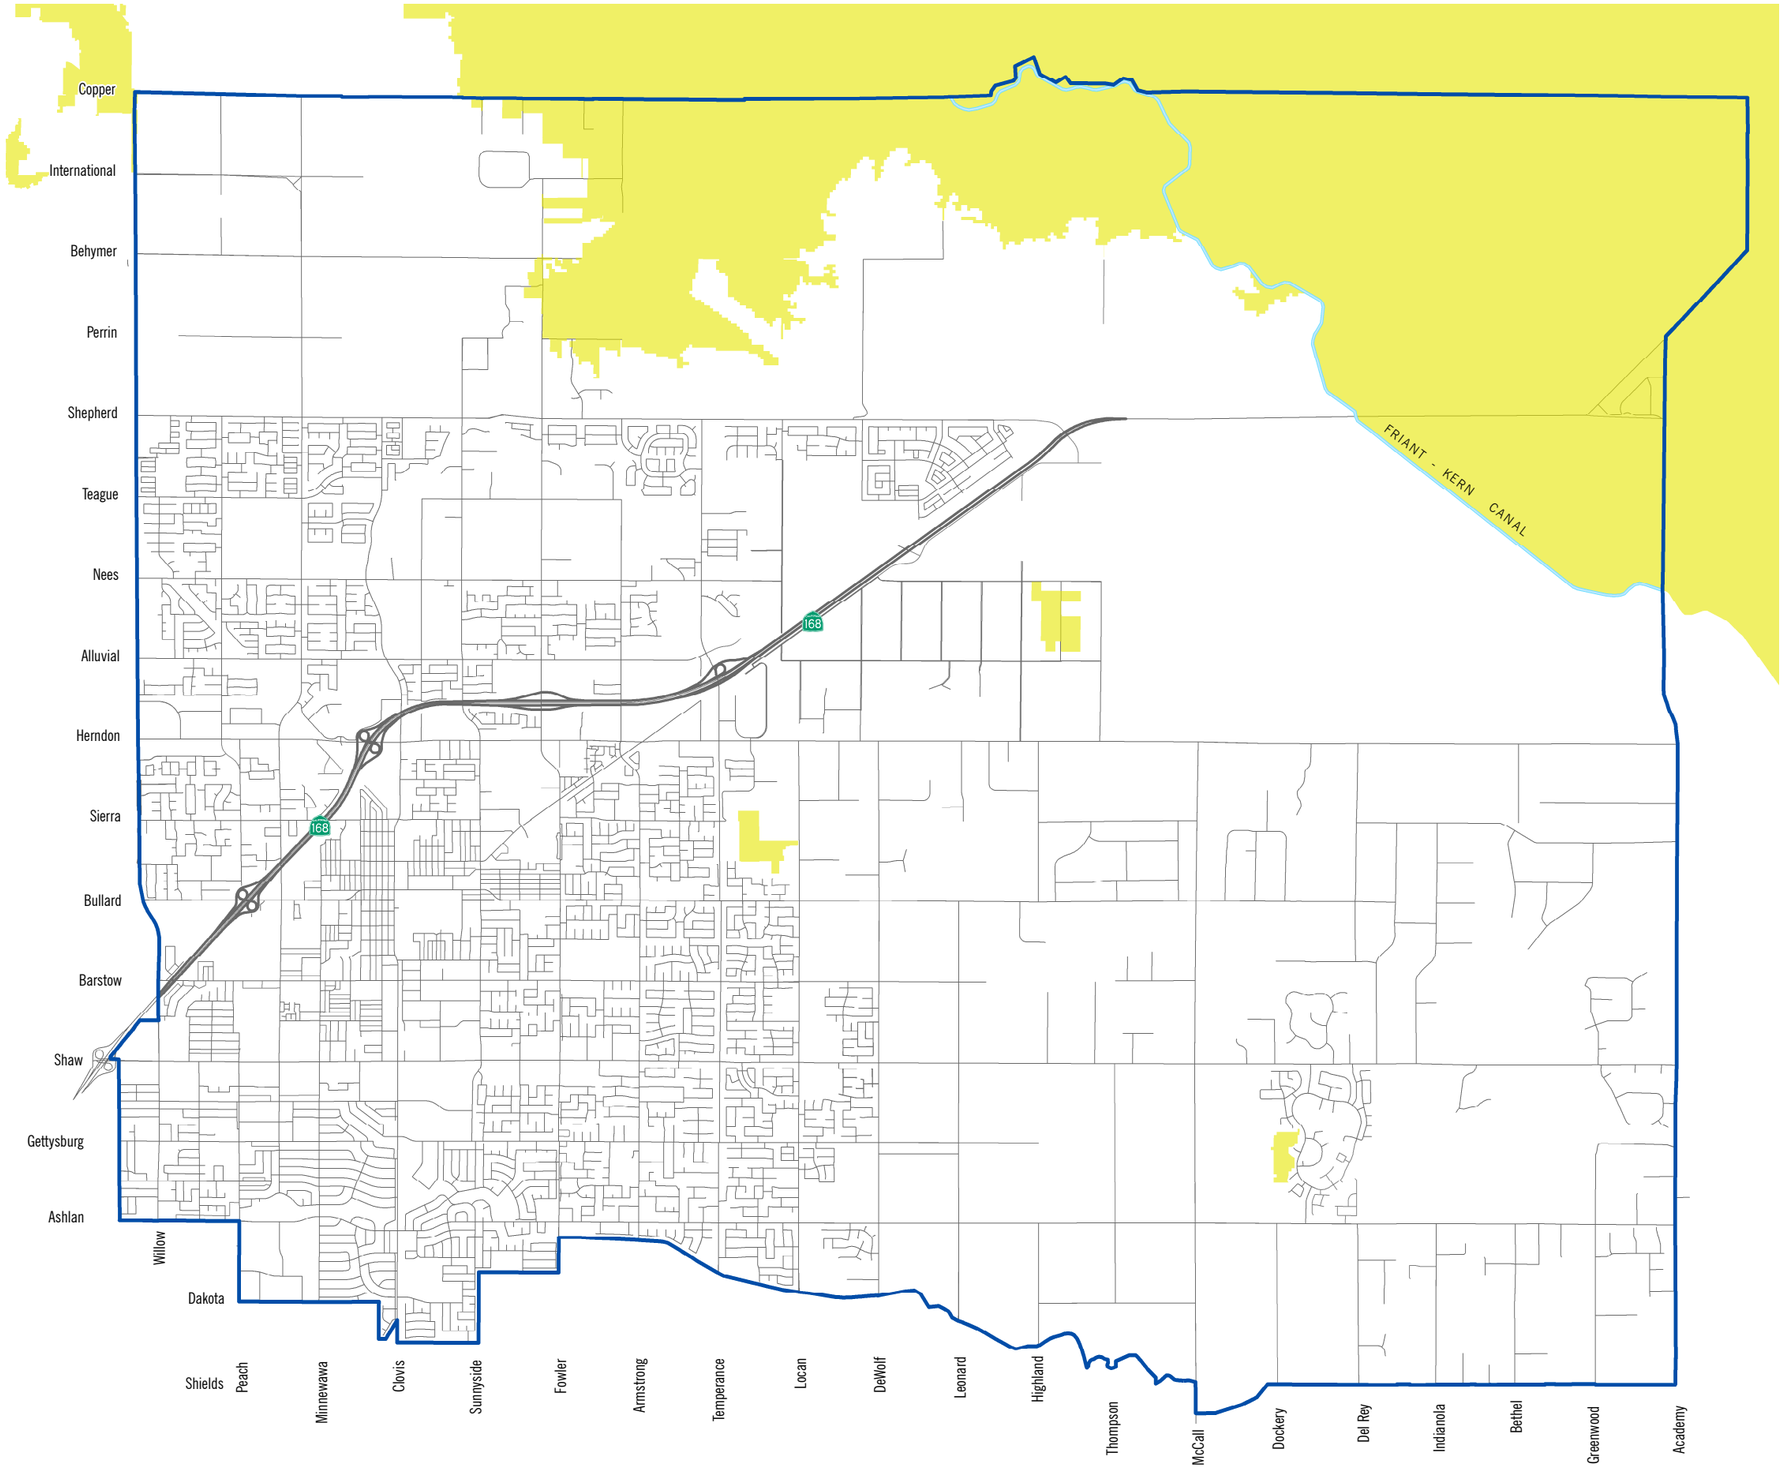

Planning Area Boundary

Fire Hazard Severity
- Very High
- High
- Moderate

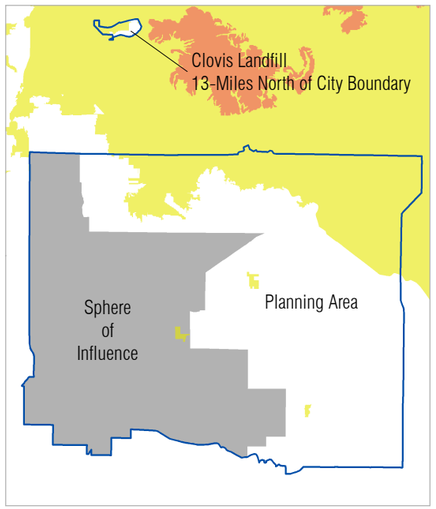

CLOVIS GENERAL PLAN

CLO - 14.0 12/8/2014

0 0.5 1 Miles

PLACEWORKS

Source: California Department of Forestry and Fire Protection, 2007.

Document Name: ES-2 Fire_Hazard_Zones_120814.MXD